




**XL SERIES
SUPER QUIET BATHROOM EXHAUST FAN**

The QB-80 fan is specially designed for bathrooms in apartments where exceptionally low noise level is required. It is available with mounting brackets for easy installation. The QB-80 is constructed of corrosion resistant heavy gauge satin coat steel. The fan is certified by California Energy Commission in accordance with California Law - Title 20. It also meets Washington State Ventilation and Indoor Air Quality Code.

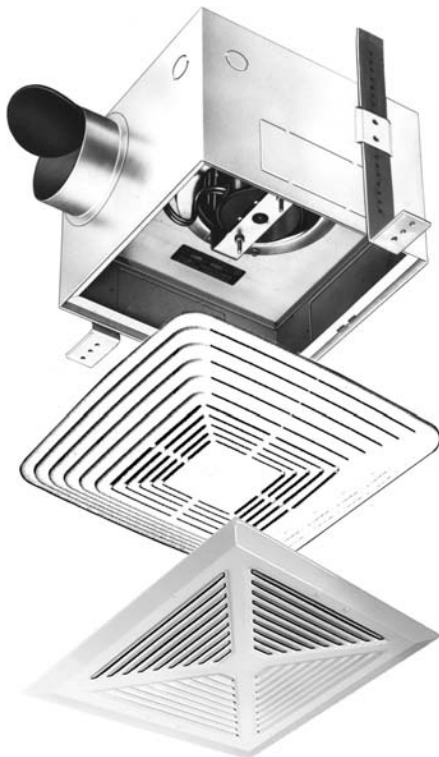


Plastic Backdraft Damper

High Impact Styrene Grille

White Aluminum Louvered Grille

QB-80 FAN DATA

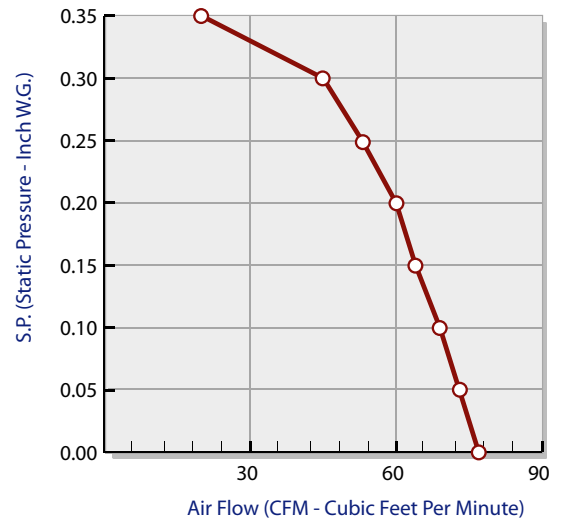

ACCESSORIES

Standard:

- Plastic snap-in grille
- Mounting brackets
- Plastic backdraft damper or metal collar with neoprene damper


Optional:

- Variable speed control
- Aluminum backdraft damper
- Off white aluminum louvered grille
- Baffle
- Inline transition
- Balance box



Reversomatic Manufacturing Ltd.

790 Rowntree Dairy Road, Woodbridge, ON Canada L4L 5V3 • Tel: 905-851-6701 • Fax: 905-851-8376
www.reversomatic.com • info@reversomatic.com

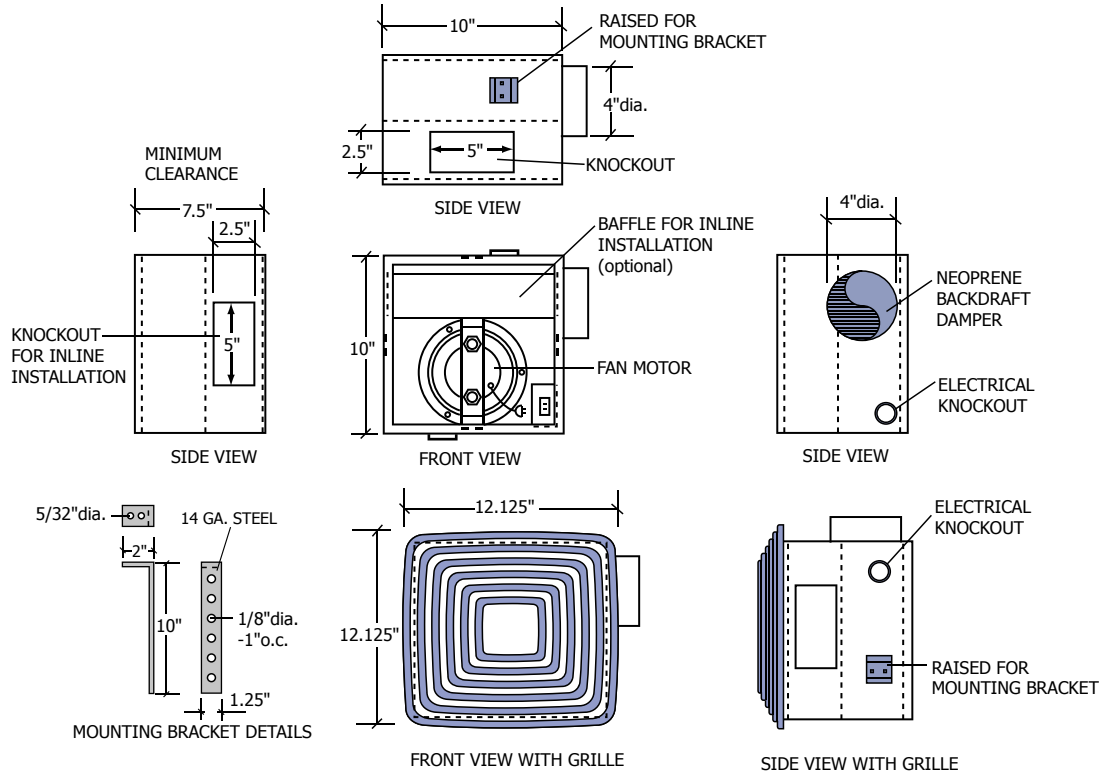

HVI CERTIFIED RATINGS

MODEL	SONES	CFM @ 0.10" S.P.
QB-80	2.0	60

FAN DATA

MODEL	MOTOR 120 VAC 60 Hz			CUBIC FEET PER MINUTE							
	RPM	AMPS	S.P.	0.00	0.05	0.10	0.15	0.20	0.25	0.30	0.35
QB-80	1000	0.35	CFM	77	73	69	64	60	53	45	20

RPM (Revolution Per Minute) shown is nominal and performance is based on actual speed of test. Unit was tested with inlet grille, backdraft damper and outlet duct.

SOUND RATING

OCTAVE BAND		1	2	3	4	5	6	7	8
CENTER FREQUENCY Hz		63	125	250	500	1000	2000	4000	8000
STATIC PRESSURE INCH W.G.	0.00	62.0	53.1	49.5	51.3	45.6	39.2	41.2	45.0
	0.19	61.7	54.0	48.6	48.4	46.2	38.5	39.9	42.2
	0.41	61.5	56.1	51.1	49.3	44.6	38.9	41.1	48.1

The sound power level ratings shown are in decibels, referred to 10⁻¹² watts calculated per AMCA Standard 301. Values shown are for inlet Lwi sound power levels for installation Type B: free inlet, ducted outlet. Ratings do not include the effects of duct end correction.

Contractor:		QB-80		
Architect:	Job:	Date	Supersedes	Drawing NO.
Engineer:	Date Submitted:			

Reversomatic Manufacturing Ltd.